

32542-ME

Multifunction DC Panel Meter 10KW

Back-lit, Snap-in LCD panel meter that measures DC Volts, Amps, Watts, Watt hours.

Ideal for submetering and monitoring. Terminal Strip for Connections & Back Cover.

Adjustable Over/Under voltage Alarm (Backlight Flashes.)

Ideal for submetering and monitoring.

Terminal Strip for Connections & Back Cover.

Input Voltage: 6.5-100VDC

Resolution: .01V

Input Range Amps: 0-100A

Resolution: Amps: .01

Watts: 0-10KWmax

Resolution: <1KW=0.1W, <10KW=1W

Energy Used: 0-9999KWH

Resolution: <10KWH=0-9999WH, >10KW=9999KW

Accuracy: +-1% +-1LSD

Shunt: 100A Supplied

Cutout: 84.6mm X 44.6mm

W: 3-9/16"



H: 2"

D: 1"

WT: .2



← BUTTON

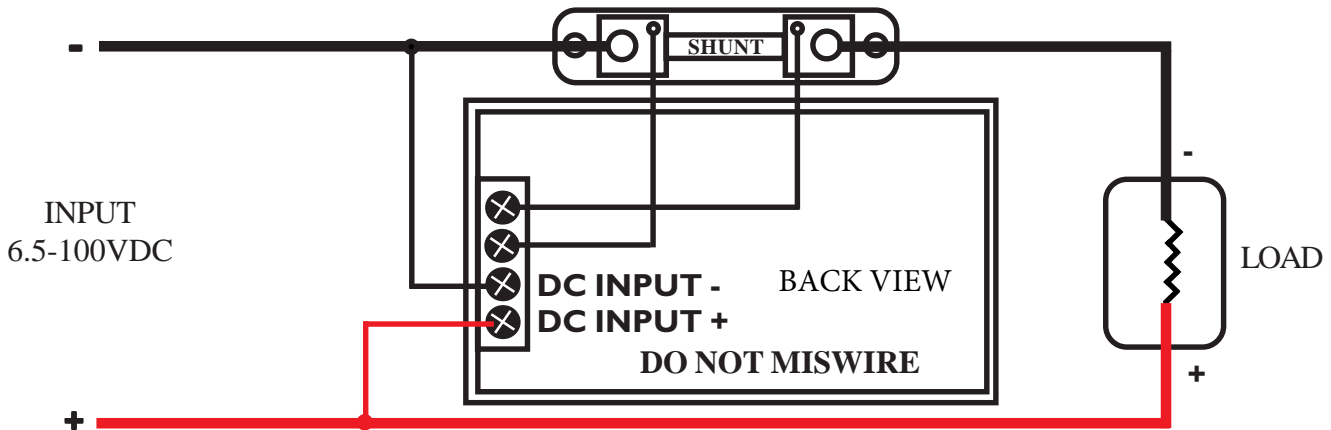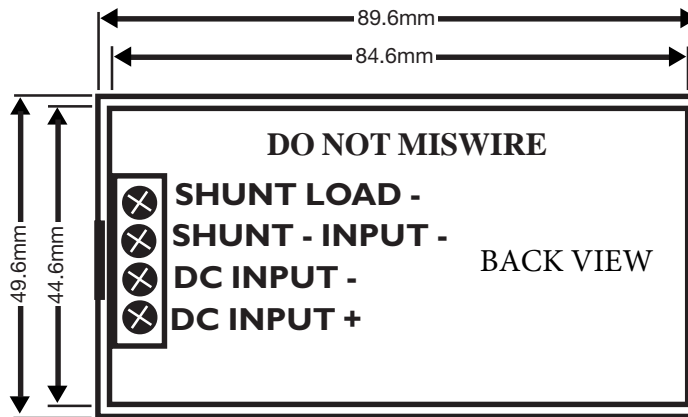

Information obtained from or supplied by Mpja.com or Marlin P. Jones and Associates inc. is supplied as a service to our customers and accuracy is not guaranteed nor is it definitive of any particular part or manufacturer. Use of information and suitability for any application is at users own discretion and user assumes all risk.



MARLIN P. JONES & ASSOC., INC.

P.O. Box 530400 Lake Park, FL 33403

800-652-6733 FAX 561-844-8764

WWW.MPJA.COM

32542-ME

Multifunction DC Panel Meter

10KW

PANEL OPERATION

NOTE: Cumulative Watt-Hrs (ENERGY) & Backlight on/off status are retained with power off

Backlight: Short press of Button to cycle backlight ON/OFF

To Set OVER/UNDER VOLTAGE ALARM value

- 1: Press & Hold the Button Until the POWER displays "**SET**" then release
- 2: The VOLTAGE Display will show the present Overvoltage value
The CURRENT Display will show the present Undervoltage value
and the last digit on Left (VOLTAGE Display) will flash
- 3: Momentarily press the Button to increase the value by 1 until your value is reached
- 4: Wait 3 seconds and the next Digit to the Right will flash
- 5: Repete step 3 & 4 until all 3 High Voltage & 3 Low Voltage digits are set
- 6: Press and hold the Button until the screen displays "**PASS**" to store the setting
and exit to normal operation

To Reset ENERGY (Watt/Hrs) cumulative value

- 1: Press & Hold the Button for until the POWER display flashes "**CLr**" then release
- 2: Momentarily press the Button to clear value and exit to normal operation
If there is no action within 5 seconds, then value will not reset and operation will return to normal

Information obtained from or supplied by Mpja.com or Marlin P. Jones and Associates inc. is supplied as a service to our customers and accuracy is not guaranteed nor is it definitive of any particular part or manufacturer. Use of information and suitability for any application is at users own discretion and user assumes all risk.



MARLIN P. JONES & ASSOC., INC.

P.O. Box 530400 Lake Park, FL 33403
800-652-6733 FAX 561-844-8764
WWW.MPJA.COM