

37663-RL

Retriggerable Delay on Break Timing Relay ~1 to 99 Sec/~1 to 99 Minutes

Trigger actuated Time Delay Relay.

Action: Relay OFF at Power ON, Relay Energized at Trigger, After Delay Relay Is OFF.

Trigger during cycle will restart timing cycle.

POWER: 12VDC

Timing Range: ~1-99 Sec OR
~1-99Min (Jumper Select)

Relay:

Contacts: SPDT, 10A @ 125/
250VAC/30VDC

Power LED


Relay Energized: LED

2 Digit, .36" LED Countdown display.

Connections: Terminal Strips

L: 70mm(2-3/4") **W:** 40mm (1-9/16")

H: 20mm (7/8") **WT:** .06

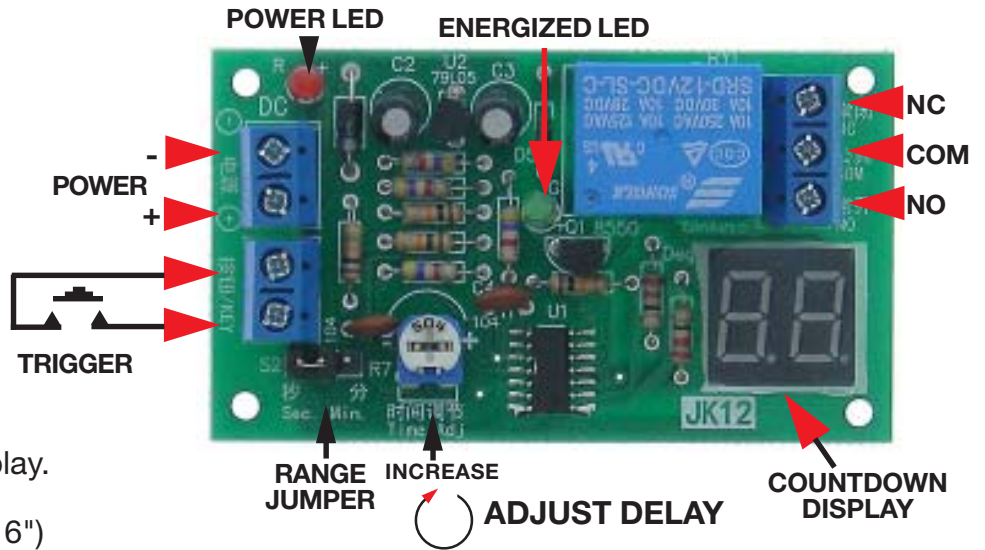

NOTES:

“KEY” Input requires a **Momentary Contact Closer.**


Will Restart Timing Cycle upon Retrigger During Cycle

Will Not Time out as Long as Trigger is Present

Module is Leading Edge Triggered.

Delay Starts when the “KEY” contacts are Shorted

Display is Dimmed During Countdown”

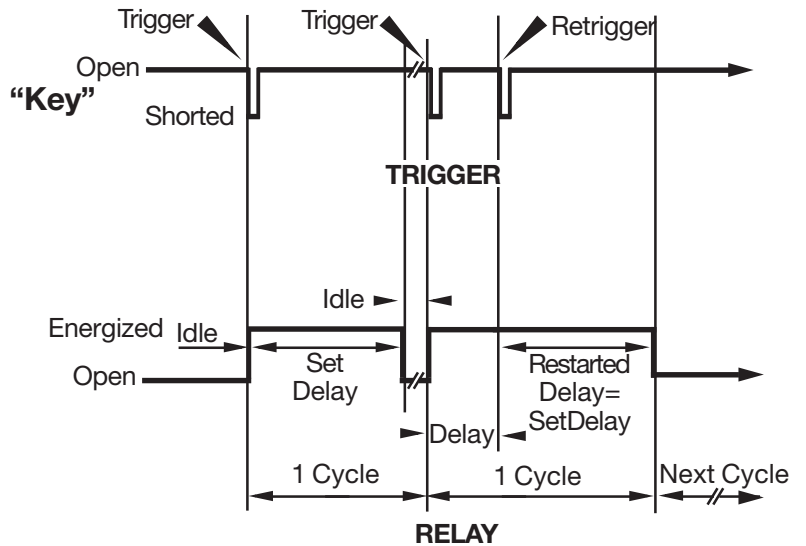

Information including Drawings, Schematics, Links and Code (Software) Supplied or Referenced in this Document is supplied by MPJA inc. as a service to our customers and accuracy or usefulness is not guaranteed nor is it an Endorsement of any particular part, supplier or manufacturer. Use of information and suitability for any application is at users own discretion and user assumes all risk.

Information Subject to Change Without Notice
All rights are retained by the respective Owners/Author(s)



MARLIN P. JONES & ASSOC., INC.

P.O. Box 530400 Lake Park, FL 33403
800-652-6733 FAX 561-844-8764
WWW.MPJA.COM